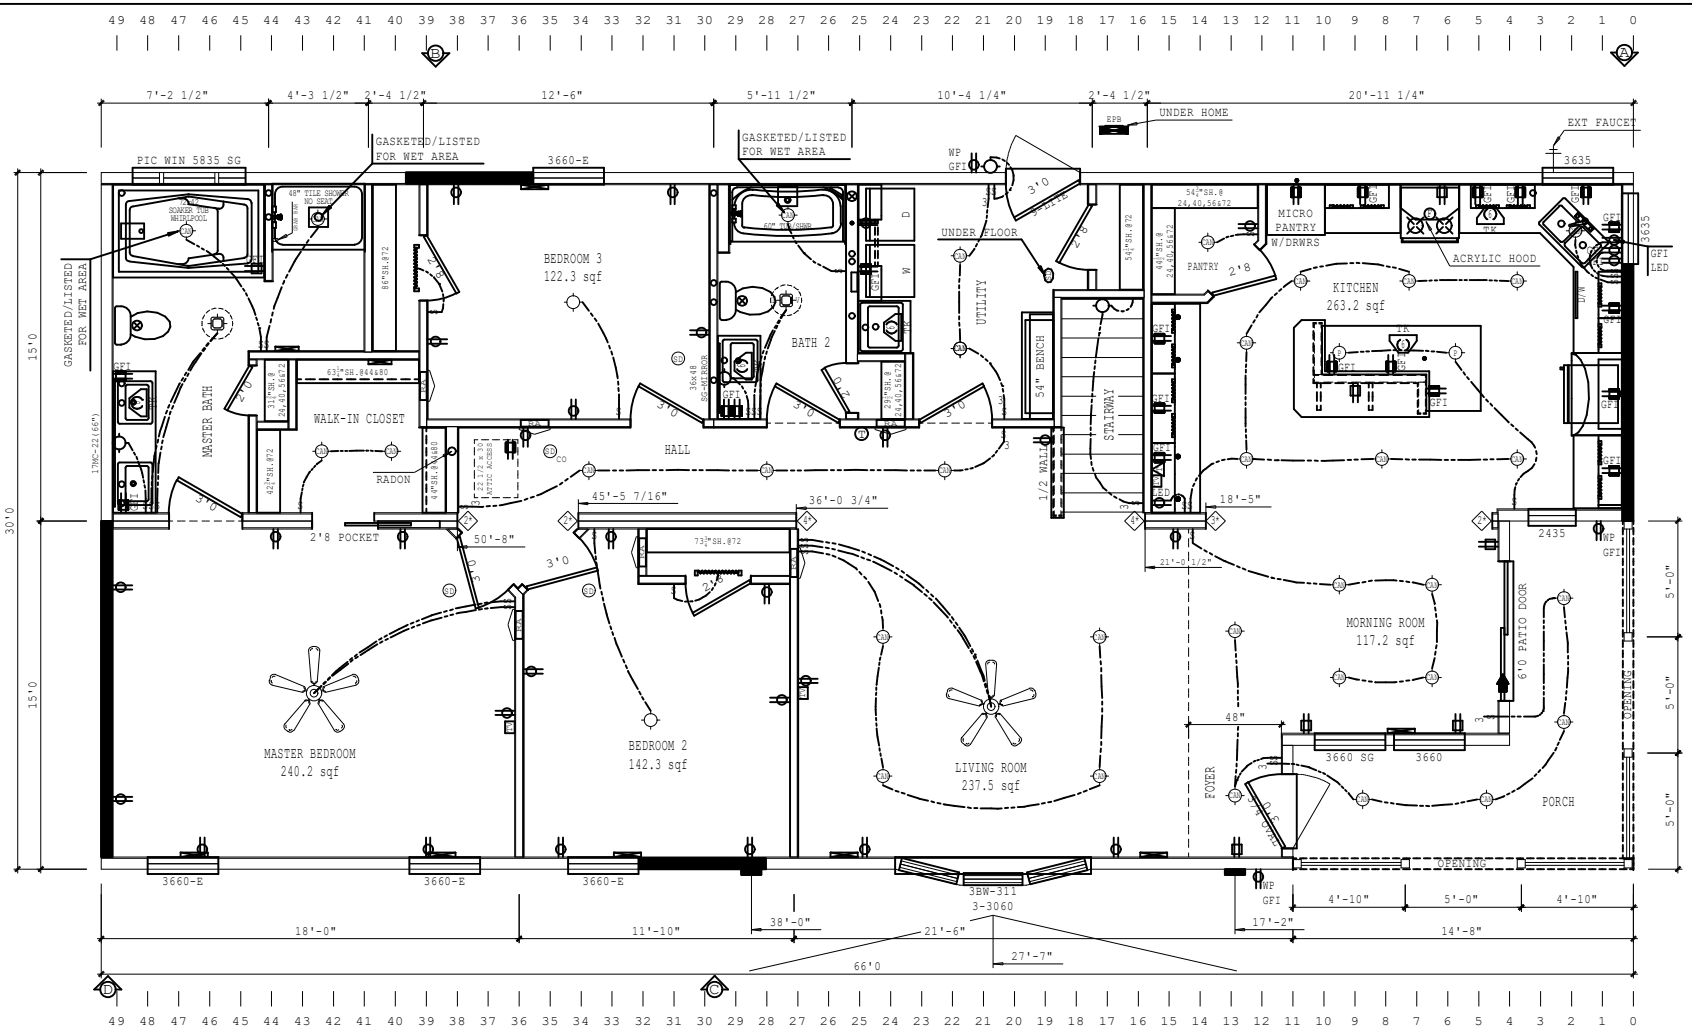

NOTE: HVAC TO BE DESIGNED, SUPPLIED & INSTALLED ON-SITE BY OTHERS

WIND-90		DIAPHRAGM = 237C				DIAPHRAGM = PLF						DIAPHRAGM = PLF						DIAPHRAGM = PLF						DIAPHRAGM = PLF						DESIGN LOADS
SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	SHEARWALL	DESIGN PLF	SHEAR AREA	JOISTS	WIND-ROOF PSF
A	489 PLF	132"	2	A				A				A				A				A				A				A				90-40
B	320 PLF	66"		B				B				B				B				B				B				B				
C	320 PLF	66"		C				C				C				C				C				C				C				
D	320 PLF	FULL"	2	D				D				D				D				D				D				D				
E				E				E				E				E				E				E				E				
F				F				F				F				F				F				F				F				
G				G			where TABLE 16 = 1	G				G				G				G				G				G				

RETURN AIR REQUIREMENTS
1 20"x16" GRILL REQUIRED
2 4"x10" GRILL W/ 2 1/2" DOOR UNDERCUT
3 DOOR(S) MUST BE UNDERCUT 2 1/2" MIN.
4 4"x24" OR 6"x14" GRILL REQUIRED

1 INDICATES REQUIRED NUMBER OF STUDS IN COLUMN

2* THE * SPECIFIES THAT THERE CAN BE NO HOLES IN STUDS IN COLUMNS

BRAND	SERIES
SCHULT	MD32

CLAYTON HOME BUILDING GROUP

REVISIONS	BY	DATE

GENERAL NOTES

CEILING HEIGHT = 96.00

FLOOR FRAMING SPACING = 16

TOTAL WINDOW SQFT =165.6

DRAWING TITLE

MASTER PLAN

MODEL NAME	SQ. FT.
FREEDOM-368641	1850

PLANT	DESCRIPTION	MODEL NO.
954	32X66' 3BR-2BA	MR6432-13

DRAWN BY	ORIG. DATE	DATE PRINTED	SHEET NO.
DRT	07/26/2019	08/12/2019	1-1